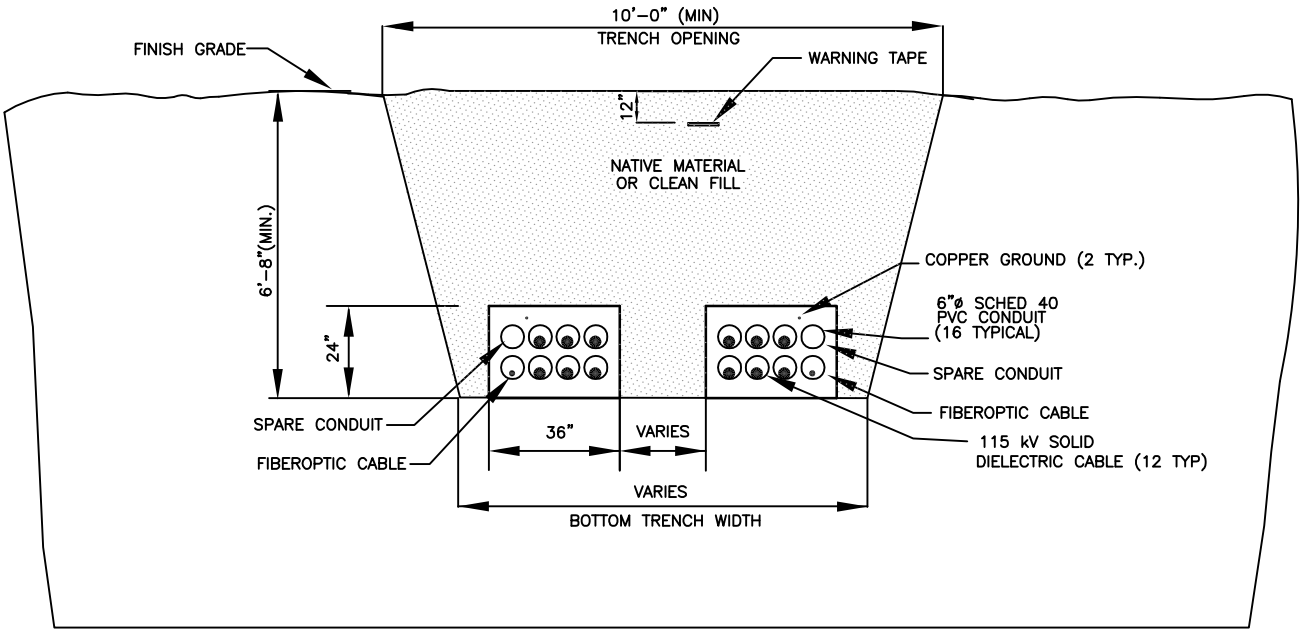

UPLAND CABLE TRENCH 4-OVER-4 CROSS-SECTION (IN ROADWAYS)
CONCRETE ENCASED DUCTBANK

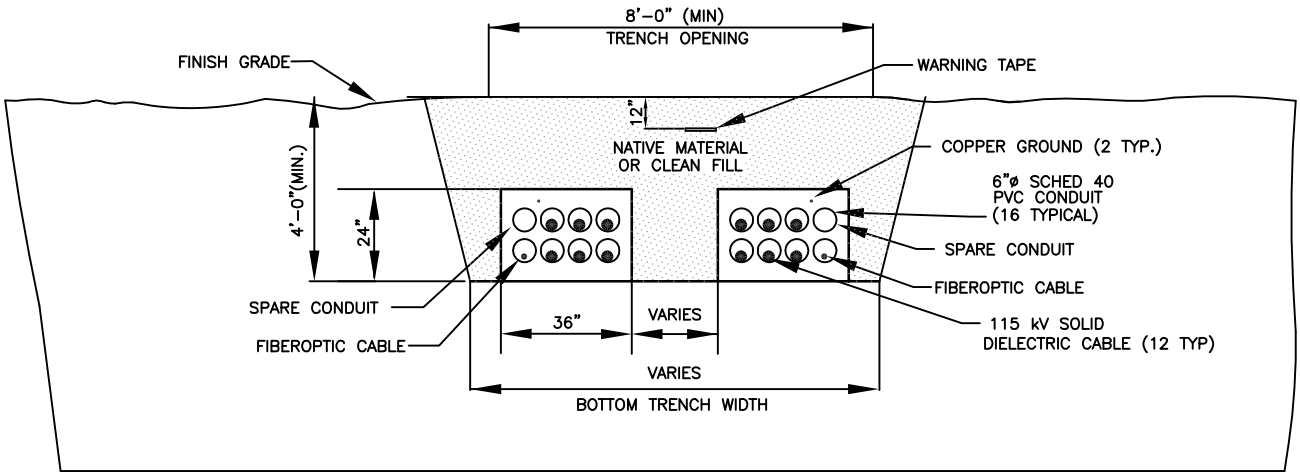

UPLAND CABLE TRENCH 4-OVER-4 CROSS SECTION (IN R.O.W.)
CONCRETE ENCASED DUCTBANK

NOTE:
NATIVE MATERIAL TO BE USED ONLY IF DETERMINED TO HAVE APPROPRIATE THERMAL RESISTIVITY AND TO BE ACCEPTABLE IN ACCORDANCE WITH THE SOIL MANAGEMENT PLAN.

H:\E159\DEIS-DEIR\UPLAND-TRANSITION-VAULTS-111303\E159-DEIS-DETAILS-111303.DWG

CAPE WIND ENERGY PROJECT
Typical "4-over-4"
Ductbank Cross-Section
(Not To Scale)
Figure 2.1.3-5